



Storage and Labeling of Chemicals (especially flammable gases and liquids)

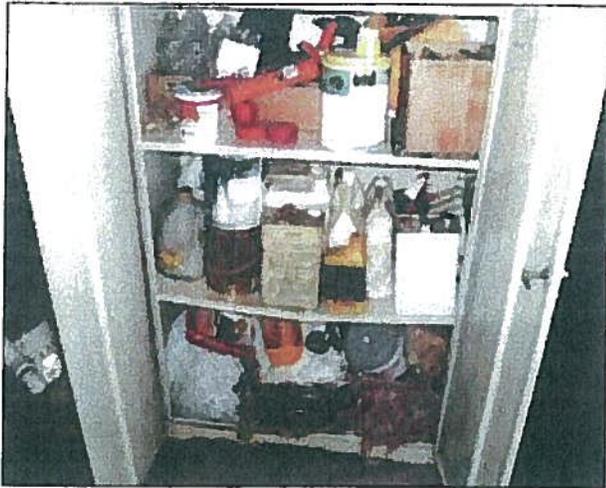


Inappropriate storage. Move non-flammable materials outside cabinet. Consider an approved flammable storage cabinet like the one below.

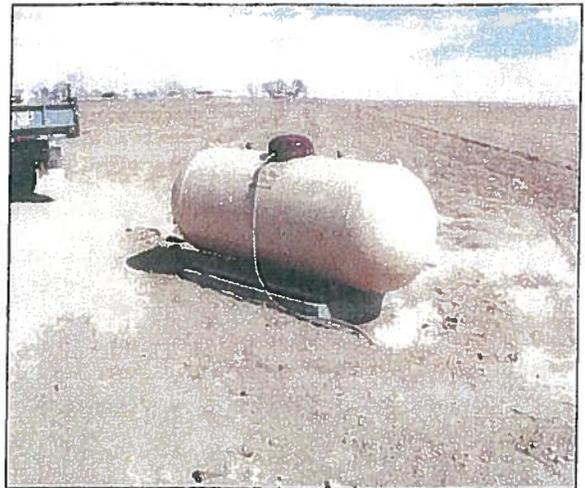

No protection or labeling. Label the propane tank with the NFPA 704 diamond and install bollards or other means to protect the cylinder.




Fire hazard — gas containers stored around and above flammable storage cabinet. Segregate gasoline away from the storage cabinet or obtain other cabinet.

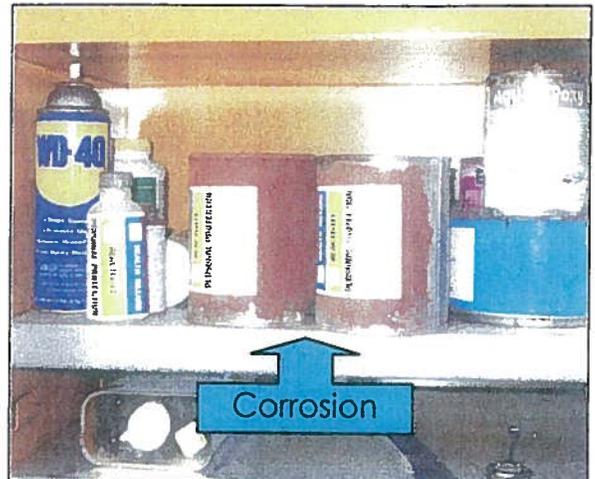

Fire and explosion hazard — outdated, corroded chemicals. Dispose of the corroded containers through hazardous waste collection drive.



Fire hazard. Store propane in separate area, away from property/evidence.

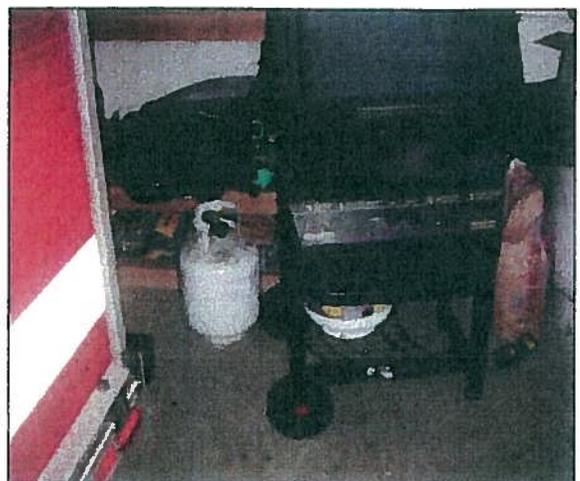

Propane stored near an ignition source. Segregate flammable storage away from ignition, fuels, or potential collision.